

HYUNDAI
POWER PRODUCTS


PORTABLE SILENCED DIESEL GENERATOR

DHY6000SE/LR, DHY8000SE/LR, DHY8000SELR-T

Instruction Manual



GENUINE PRODUCT OF
HYUNDAI CORPORATION

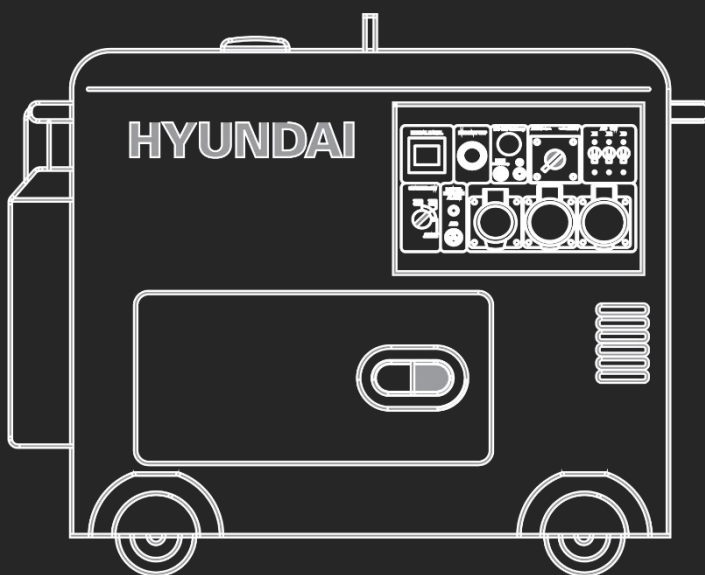

WARNING: Read the instructions carefully before use.

Iss. Nov/25

CONTENTS

Section Description	Page N°/N°s
1. SAFETY	3 - 7
2. MACHINE LAYOUT	7 - 8
3. PREPARATION for STARTING	8 - 12
4. OPERATING THE GENERATOR	12 - 13
5. LOAD	13 -14
6. STOPPING THE MACHINE	14 – 15
7. PERIODIC MAINTENANCE	15 - 16
8. LONG TERM STORAGE	16
9. TROUBLE SHOOTING	17
10. SPECIFICATIONS	18
11. WIRING DIAGRAM	19
12. SERVICE RECORD SHEET	20
13. GENPOWER CONTACT DETAILS	21
14. DECLARATIONS OF CONFORMITY	22

1. SAFETY.

1.1. The operator of the machine is;

- 1.1.1. Responsible for and has a duty of care in making sure that the machine is operated safely and in accordance with the instructions in this user manual.
- 1.1.2. Should never be left it in a condition which would allow an untrained or unauthorised person/s to operate this machine.
- 1.1.3. All due care and diligence should be taken by the operator for the safety of and with regard to those around whilst using the machine, to include but not limited to;
 - 1.1.3.1. Elderly, children, pets, livestock and property.

1.2. Some or all of the following PPE, Warning Signs and symbols may appear throughout this manual and you must adhere to their warning/s. Failure to do so may result in personal injury.

Personal Protective clothing (PPE)



Warning Signs and Symbols

 DANGER	 CAUTION	 WARNING	 NOTE	 
 EXPLOSION	 KICKBACK	 HOT SURFACE	 SHOCK	 MOVING PARTS
	 FIRE		 TOXIC FUMES	



1.3. Carbon Monoxide

- 1.3.1. Carbon monoxide is a colourless and odourless gas breathing this gas. It can cause death as well as serious long term health problems such as brain damage.
- 1.3.2. The symptoms of Carbon monoxide poisoning can include the following;
 - 1.3.2.1. Headaches, Dizziness, Nausea, Breathlessness, Collapsing or Loss of consciousness.
 - 1.3.2.2. Carbon monoxide symptoms are similar to flu, food poisoning, viral infections and simply tiredness. That's why it's quite common for people to mistake this very dangerous poisoning for something else.
- 1.3.3. To avoid Carbon monoxide poisoning DO NOT Use Petrol/Diesel powered equipment inside a home or garage even if doors and windows are open.
- 1.3.4. If you think you or someone around you has been affected by carbon monoxide poisoning;
 - 1.3.4.1. Get fresh air immediately.
 - 1.3.4.2. Open doors and windows, turn off machine and leave the affected area.
 - 1.3.4.3. See your doctor immediately or go to hospital - let them know that you suspect carbon monoxide poisoning.
- 1.3.5. Only use Petrol/Diesel powered equipment outside in a well-ventilated area.



1.4. General fuel safety.

- 1.4.1. Fuel Safety additional information can be obtained from the Health and Safety Executive (HSE) document SR16.
- 1.4.2.  **CAUTION** All fuels are Flammable.
- 1.4.3. Keep away from all ignition sources i.e. Heaters, Lamps, sparks from Grinding or welding.
- 1.4.4. Hot work on tanks that have contained fuel is extremely dangerous and should not be carried out.
- 1.4.5. Keep work area clean and tidy.
- 1.4.6. Clean up all spills promptly using correct methods i.e. absorbent granules and a lidded bin.

1.4.7. Dispose of waste fuels correctly.



1.4.8. Diesel safety.

- 1.4.8.1. Always fuel and defuel in well-ventilated area.
- 1.4.8.2. Always wear correct, suitable and fit for purpose Personal Protective Equipment (PPE), suggested items are as follows, but are not limited too.



- 1.4.8.3. Hand protection.



- 1.4.8.4. Protective clothing.



- 1.4.8.5. Respiratory protective equipment should be used when in an unventilated area.

- 1.4.8.6. When defueling always use a propriety fuel retriever.
- 1.4.8.7. Always carry fuel in the correct and clearly marked container.



1.4.9. Petrol safety.

- 1.4.9.1. Always fuel and defuel in well-ventilated area.
- 1.4.9.2. Always wear correct, suitable and fit for purpose Personal Protective Equipment (PPE), suggested items are as follows, but are not limited too.



- 1.4.9.3. Hand protection.



- 1.4.9.4. Protective clothing.



- 1.4.9.5. Respiratory protective equipment should be used when in an unventilated area.

- 1.4.9.6. When defueling always use a propriety fuel retriever.
- 1.4.9.7. Always carry fuel in the correct and clearly marked container.



1.4.10. Electrical Safety.

- 1.4.10.1. Electricity can kill - never work on LIVE/ENERGISED equipment.
- 1.4.10.2. Identify electrical isolation method and always isolate all electrical supplies, prior to carrying out any maintenance work.
- 1.4.10.3. Prior to use and with all electrical supplies isolated check all electrical cables, plugs and connections for the following.
 - 1.4.10.3.1. Are intact and have no signs of damage, to include but not limited to bare wires, chaffing, cuts and loose wiring. If there are any signs of damage, the damaged item should be taken out of service until the damage has been repaired by an electrically competent person.
- 1.4.10.4. All trailing cables should be routed so as not to cause any kind of trip hazard.

- 1.4.10.5. Never work on or near electricity with wet hands, wet clothing, and wet gloves.



- 1.4.10.6. Batteries present a risk if they become damaged by the possible leaking of electrolyte. This electrolyte is an acid and can cause serious injuries. Care should be taken when working on or near them.

- 1.4.10.6.1. Should you come into contact with acid you should;

1.4.10.6.1.1. Remove all clothing contaminated with acid.

1.4.10.6.1.2. Get medical assistance as soon as possible.

1.4.10.6.1.3. Use fresh running water to wash off excess acid, continue this until medical assistance arrives.

1.4.10.6.1.4. If acid comes into contact with eyes the acid needs to be immediately washed away. Make sure that you do not wash the acid to another part of the face or body.

1.4.10.6.1.5. Gases from charging batteries are highly flammable and great care should be taken to charge in well ventilated areas.

1.5. Additional Safety guidelines'

1.5.1. Exhaust and Engine

1.5.1.1. The engine and exhaust will become very hot during use do not touch.

1.5.1.2. These items remain hot for some time after use.

1.5.1.3. Place the machine in an area where pedestrians or children are not likely to touch the machine.

1.5.1.4. Avoid placing any flammable materials near the exhaust outlet during operation.

1.5.1.5. Keep the machine at least 1 m from buildings or other equipment, or the engine may overheat.

1.5.1.6. Avoid operating the engine with a dust cover.

1.5.2. Control Functions

1.5.2.1. Oil Warning System

1.5.2.1.1. When the pressure switch senses low oil pressure the engine will stop automatically.

1.5.2.1.2. Unless you refill with oil the engine will not start again.

1.5.3. Starter Switch (SW)

1.5.3.1. The engine starter switch controls the ignition.

1.5.3.2. In the 'OFF' Position the ignition circuit is switched off and the engine will not run

1.5.3.3. In the 'ON' position the engine is ready for starting

1.5.3.4. In the 'START' position (pushed against spring tension) the starter motor is engaged and the machine will start.




1.5.4. AC Switch (Breaker)



1.5.4.1. The AC Switch (Breaker) will turn 'OFF' automatically when the load exceeds the generator output.



1.5.4.2. If AC switch turns 'OFF' then before resetting remove some of the load and keep below the rated output of the machine.

1.5.5. DO NOT Connect the generator to Mains AC sockets in your building – commonly known as 'back feeding' it is extremely dangerous and illegal.

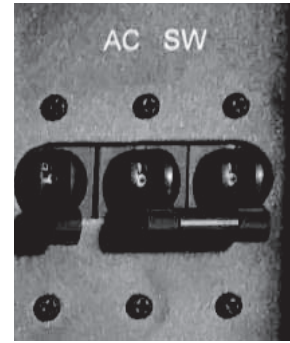

2. MACHINE LAYOUT

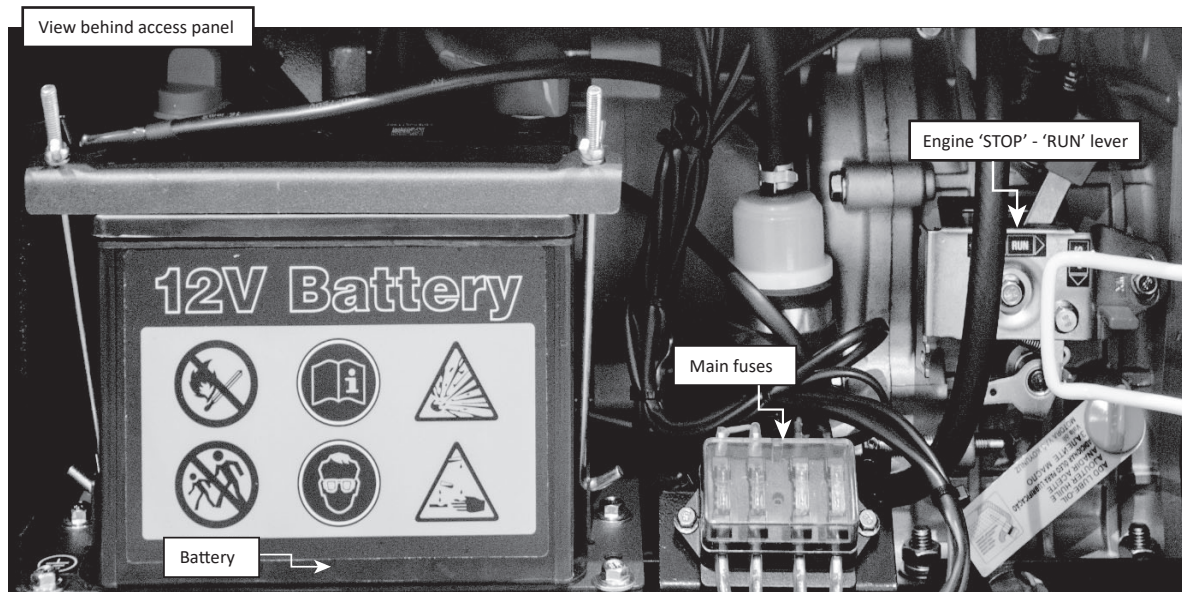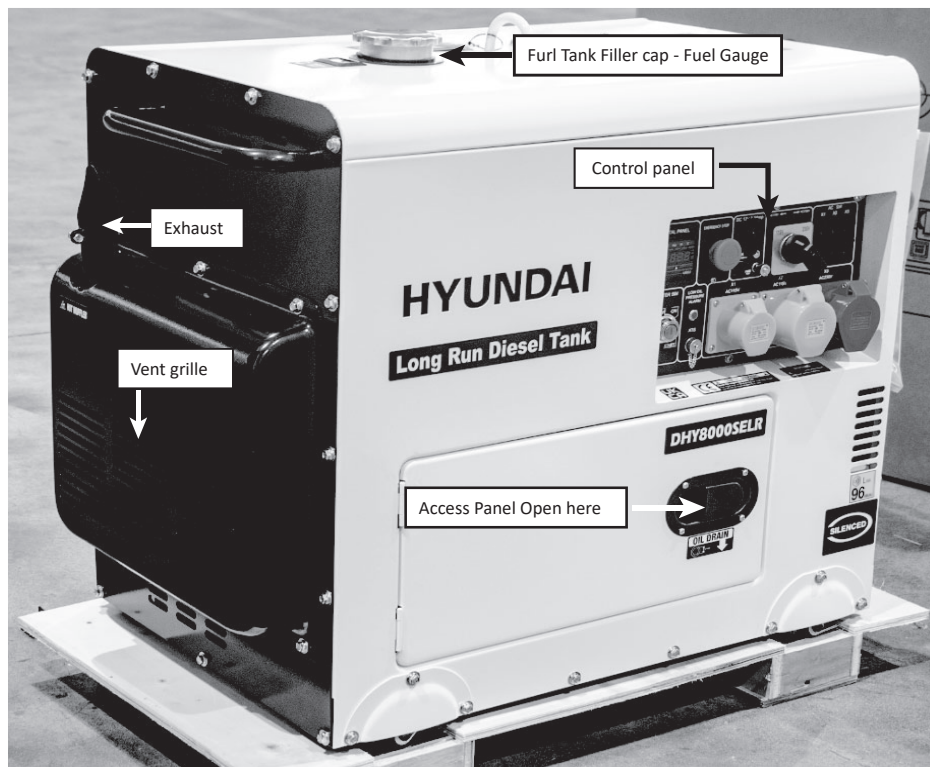

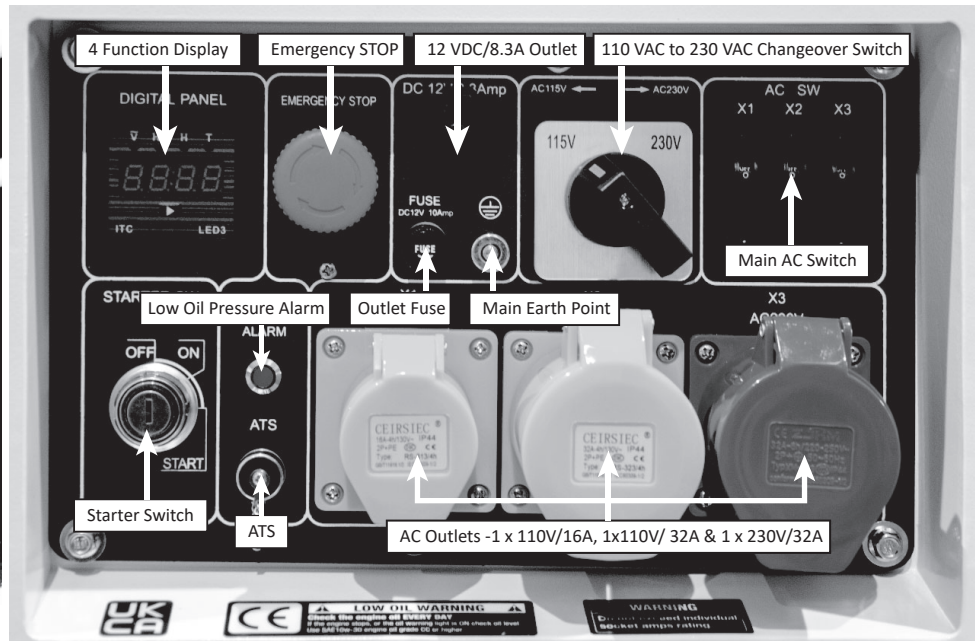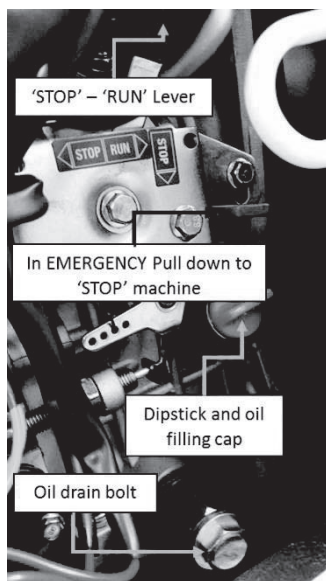

3. PREPARATION for STARTING

WARNING

- DO NOT refill tank while engine is running or HOT.
- Do not smoke or allow flames or sparks in the area where the engine is refuelled or where the fuel is stored.
- Do not overfill the diesel tank and make sure the filler cap is securely closed after refuelling.
- Take care not to spill fuel when refuelling. If any fuel is spilled, make sure the area is clean and dry before starting the engine.

CAUTION

Wear suitable PPE, suggested but not limited too



3.1. Selection and handling of fuel.

3.1.1. Selection of fuel.

- 3.1.1.1. Only use standard specification diesel, this can be red or white.
- 3.1.1.2. Keep dust and water out of the fuel.
- 3.1.1.3. When filling the fuel tank from drums, make sure that no dust or water is mixed in with the fuel. This can cause serious damage to the fuel injection pump or the injector nozzle.
- 3.1.1.4. Do not overfill. Overfilling can potentially be very dangerous. Diesel can expand in hot weather and overflow
- 3.1.1.5. Always leave a 25mm gap above the fuel level.

WARNING

- Always check the engine oil level with the generator on a flat, level surface before starting or refilling the machine.

- If an insufficient amount of engine oil is used, damage to the engine may result.
- Do not overfill the engine with oil.
- This generator is equipped with a low oil pressure switch this system will stop the engine automatically when the oil pressure falls below the minimum pressure required.
- This helps prevents damage such as bearing seizures etc. However, this should not be relied upon and the engine oil level should be checked and topped up if required, daily.

⚠ CAUTION

Wear suitable PPE, suggested but not limited too



3.2. Check and refill the engine oil.



3.2.1. To ensure the generator maintains an optimum performance and the life of the generator is as long as possible, it is important to use the correct engine oil – SAE10W/30 – SAE15W/40 (**API CH-4/CF/SJ/SL diesel engine oil or higher grade**) and **change after the first 20 hours, then every 100 hours.**

3.2.2. If the correct engine oil is not used, or the engine oil is not replaced every 100 hours, as required, the risk of crankshaft bearing failure, piston seizure, piston ring sticking and accelerated wear of the cylinder liner, main bearing and failure of other moving components increases significantly. The generator lifespan will be greatly reduced if oil level and oil changes are reduced.

3.2.3. Remove oil filler cap and check engine oil level

3.2.4. If oil level is below the lower level line, refill with SAE API CH-4/CF/SJ/SL diesel engine oil on dipstick, or to the top of filler neck. N.B. do not screw oil filler in the oil filler cap when checking oil level.

3.2.5. Change contaminated oil.

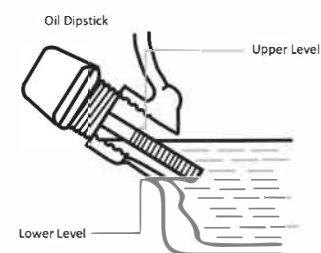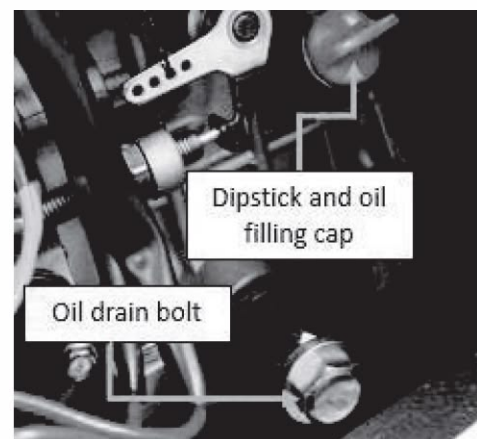


3.3. Service the Air Cleaner.

⚠ WARNING

- Do not wash air filter with detergent.
- Replace the air filter if the engine output decreases or excessive exhaust smoke is noticed.
- Never run the generator without the air filter, otherwise rapid engine wear will result.

- 3.3.1. Remove the access panel to reveal air filter cover.
- 3.3.2. Undo the nut (anti-clockwise) and remove the air cleaner cover and take out the element.
- 3.3.3. Clean the air filter.
- 3.3.4. Reattach the air filter cover and screw on the nut.

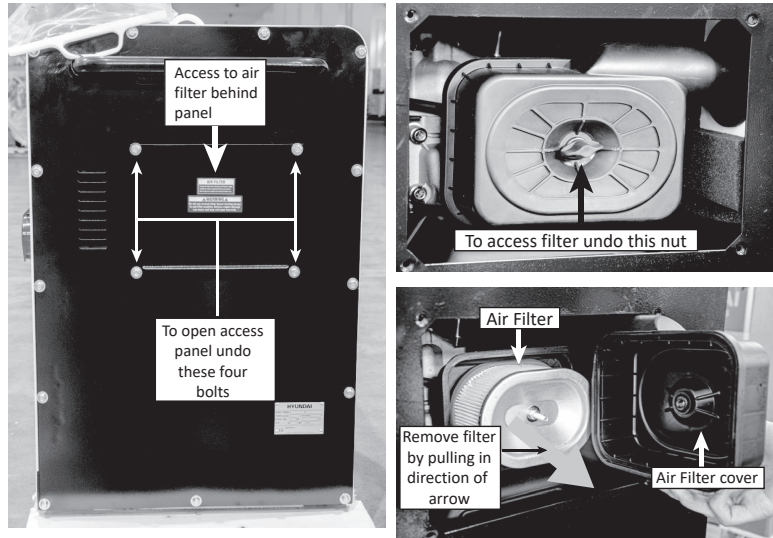

3.4. Checking the Generator before start up.

WARNING


- Be sure to turn off the main breaker switch before starting. The generator should be earthed to prevent electric shocks.
- Turn off the main breaker switch and remove all loads.

CAUTION

- Before starting the engine, be sure to switch OFF any appliances connected to it.
- Ensure that the breaker switch is OFF before switching between 115v/230v.

3.5. Running-in periods of Operation.

- 3.5.1. The first 20 hours are the break-in period of the engine. For this reason, it is important to follow the following instructions during this period.
 - 3.5.1.1. Warm up the engine 5 minutes after the initial starting, before applying load.
 - 3.5.1.2. Avoid applying loads above 3kw during the first 20 hours of operation.
 - 3.5.1.3. It is important to replace the engine oil on time.
 - 3.5.1.4. Replace the engine oil whilst the engine is warm, after 20-hours running.
 - 3.5.1.5. Ensure that old engine oil is drained out completely.

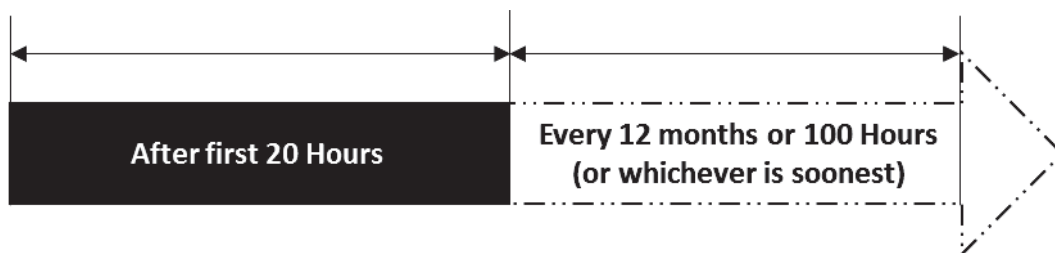

3.6. Battery.



- Do not connect tools or any other appliances to the generator before starting.



- Explosive gases are given off when charging battery. Only charge in a well-ventilated area, away from sparks and naked flames.

3.6.1. Battery.

3.6.1.1. When you first install the battery, ensure that the battery's polarity is the same as the generator's battery leads - Black = negative, Red = positive.

3.6.1.2. Using a voltmeter - check the voltage is 12.3V+, if lower, the battery must be charged.

3.6.1.3. Check that the voltage is correct every month. The battery should be between 12.5v and 13.6v. When the engine is running it should re-charge the battery.

3.6.1.4. Make sure battery is free from damage and is not leaking. If battery shows signs of damage or leaking – DO NOT continue to use. Instead replace battery immediately.

3.6.1.5. Make sure that all battery acid spills are correctly cleaned up straight away.

3.6.1.6. The battery should be stored in a charged condition.

3.6.1.7. The battery is a 12 volt 36Ah sealed lead acid battery and requires no maintenance other than;

3.6.1.7.1. Ensure battery terminals are;

3.6.1.7.2. Kept clean.

3.6.1.7.3. Kept tight.

3.6.1.7.4. Covered to prevent short circuiting.


3.6.1.8. If the battery voltage is too low, it will require charging before use.

3.6.1.9. Keep the battery in a cool, dry place. It is important to clean the battery every three months and charge every six months.

4. OPERATING THE GENERATOR


CAUTION

- Do not loosen or readjust either the engine speed limiting bolt or the fuel injection limiting bolt as this will cause the performance of the generator to be affected.

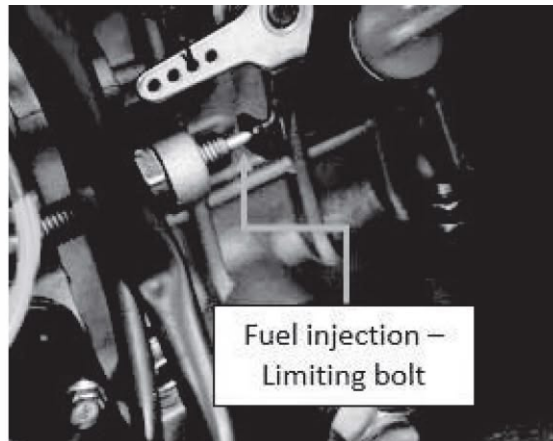


4.1. Starting.

- 4.1.1. Turn the main AC switch to the 'OFF' position.
- 4.1.2. Make sure that the machine has fuel for the task.
- 4.1.3. Make sure the emergency STOP switch is out (turn anti-clockwise).
- 4.1.4. Set the engine speed lever is set to 'RUN'.
- 4.1.5. Turn the starting key clockwise to the 'START' position.
- 4.1.6. Remove your hand from the key as soon as the engine starts.
- 4.1.7. If the engine does not start after 10 seconds, wait 15 seconds before trying again. Excessive start attempts will cause the battery to flatten.
- 4.1.8. If it does not start after 3 attempts, or runs intermittently with excessive smoke

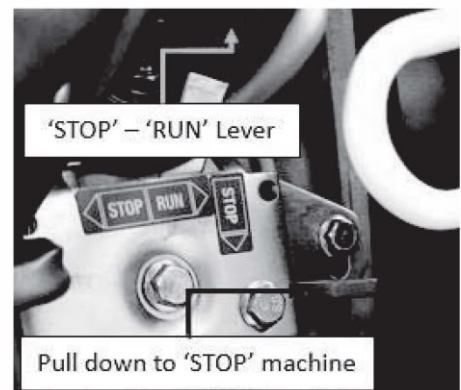


- 4.1.8.1. Priming - before starting to prime make sure that there is fuel in tank and that you can contain any fuel spilt.

- 4.1.8.1.1. It is done by releasing the pipe clip on the diesel fuel line connected to the injector pump. Make sure you pinch the fuel line and then release slowly until all air is released and fuel appears.
- 4.1.8.1.2. When fuel appears replace pipe onto the injector pump and replace clip. Clear up any fuel spills before restarting.
- 4.1.8.1.3. The above may be necessary when new, or if the machine runs out of fuel.

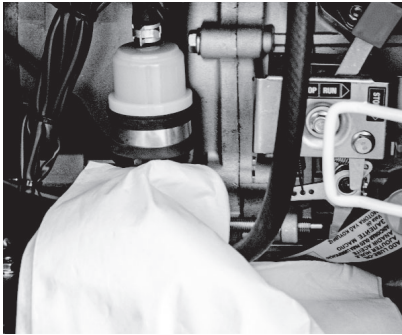


Towel to collect spilt fuel

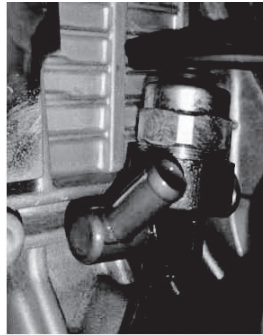

Injector pump inlet



No fuel

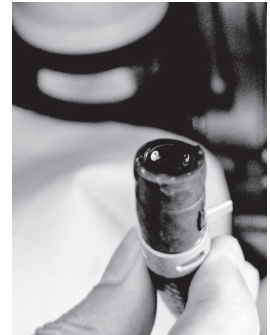

Fuel showing

- 4.1.9. Always leave the key in the 'ON' position whilst the engine is running.
- 4.1.10. Run machine for two minutes before applying load
- 4.1.11. Insert the plug into the socket you are about to use.
- 4.1.12. Turn the main AC switch to the 'ON' position and turn the electrical appliance 'ON'.

CAUTION

- If the engine has been running, the muffler will become very hot. Be careful not to touch the muffler until it has had time to fully cool down.
- Never refuel the fuel tank whilst the engine is still running.

4.2. Checks whilst generator is running.

- 4.2.1. After each use make sure that there are no abnormal sounds or vibration.
- 4.2.2. Check that the engine is running smoothly normally.
- 4.2.3. Check that there is no excessive smoke from the exhaust after 10 minutes of running, and the engine has reached working temperature
- 4.2.4. Check that there are no oil or fuel leaks.

NOTE

- If you notice any of the above, stop the engine and locate the fault.
- Please contact Genpower for assistance if required.

5. LOAD

CAUTION

- Start appliances one-by-one.

5.1. 230 Volt AC use.

- 5.1.1. After switching ON the main breaker switch, and the engine running check the Voltage reading when in 'Voltage Mode'. It should read 230v $\pm$ 5% (50Hz).
- 5.1.2. The Digital panel only becomes active when the Main breaker is in the 'ON' position. The following will be displayed by successive presses of the 'M' or mode button.



Lamp Illuminated	Indicating
V	Voltage
Hz	Frequency
T	Event timer - or current running time (hours). This will reset to zero when main Breaker is 'OFF'
H	Total Run Time

- 5.1.3. Connect the equipment to the generator in correct order.
- 5.1.4. Connecting the loads with the largest motor first, then the smaller items.
- 5.1.5. If the generator is overloaded the main breaker will trip.
- 5.1.6. To reset the breaker do the following;
 - 5.1.6.1. Turn OFF and disconnect all loads.
 - 5.1.6.2. Reset breaker, and add load onto the circuit to within 50% to 75% of rated output.
- 5.1.7. Wait a few minutes before resuming operation.

5.2. Electrical appliances, particularly motor driven equipment, will have a very high start-up current. The table below provides reference for connecting these appliances to the generator.

Type	Wattage		Typical appliance	Example		
	Starting	Rated		Appliance	Starting	Rated
Lighting	x 1	x 1	Incandescent lamp or heating appliance	Incandescent lamp 1000 watts	100 vA	100 vA
Heating Appliance						
Fluorescent Lamp	x 2	x 1 to x 1.5	Fluorescent Lamp	Fluorescent Lamp	80 vA	40 to 60 vA
Motor Driven Equipment	x 3.5	x 1 to 2	Refrigerator, Electric fan, Compressor or grinder	Refrigerator 150 watts	450 to 750 vA	150 to 30 vA

6. STOPPING MACHINE



- Do not stop the engine suddenly or whilst under load.
- This can damage the AVR and cause damage to the alternator through overheating.
- Do not stop the engine with the decompression lever.

- 6.1. Switch OFF equipment connected to the generator.
- 6.2. Turn off the main breaker switch.
- 6.3. Run the generator without load for three minutes.
- 6.4. Turn the electric key start switch to the 'OFF' position.
- 6.5. Or press or pull down the stop lever.



7. PERIODIC MAINTENANCE



WARNING

- Ensure the engine is off before performing any service.
- If the engine must be run, make sure that the area is well ventilated.
- The exhaust contains poisonous carbon monoxide gas.

7.1. Maintenance chart.

All work/s should be carried out by a competent person – if you need technical advice contact Genpower					
Item	Daily	First month or 20 hours	Every 100 hours	Every 500 hours	Every year or 1000 hours
Check and refill with diesel	Yes				
Check and refill with engine oil	Yes				
Check for oil leakage	Yes				
Check and tighten fastening parts	Yes			Yes	
Replace engine oil		Yes First oil change	Yes		
Clean engine oil filter			Yes		
Replace engine oil filter				Yes	
Replace air filter				Yes	
Replace fuel filter				Yes	
Check Fuel injection pump					Yes
Check injector nozzle					Yes
Check fuel pipes					Yes
Adjust clearance of intake and exhaust valves Intake 0.10mm – Exhaust 0.15mm		Yes – First time			Yes
Grind intake/exhaust valves					Yes
Replace piston rings					Yes
Check battery condition			Yes		
Check carbon brushes and slip rings				Yes	

7.2. Replacing engine oil.

CAUTION


After engine has been run prior to changing the oil will be very hot. Wear correct PPE minimum of gloves and overalls.



CAUTION

DO NOT allow any dust, dirt or any other debris enter oil or crankcase.

- 7.2.1. Remove the oil filler cap.
- 7.2.2. Remove the drain plug and drain the old oil while the engine is still warm.
- 7.2.3. The plug is located on the bottom of the cylinder block.
- 7.2.4. After draining, re-tighten the drain plug and refill with the recommended oil **API CH-4/CF/SJ/SL diesel engine oil or higher grade.**

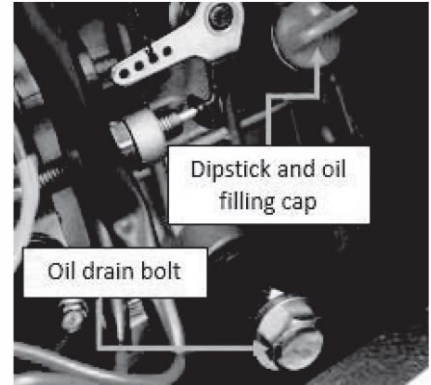

8. LONG TERM STORAGE

WARNING

- After running the engine the oil will be very hot.
- Wear correct PPE minimum of gloves and overalls.



- 8.1. If storing the generator for long periods of time, make the following operations.
 - 8.1.1. Operate the engine for 10 minutes and then stop.
 - 8.1.2. Stop the engine.
 - 8.1.3. Drain the engine oil whilst the engine is still warm and refill with fresh oil.
 - 8.1.4. Turn the engine for 2-3 seconds with the decompression lever set at the non-compression position and the starting key set at the 'START' position. (Do not start the engine.)
 - 8.1.5. Wipe off the oil and dirt from the engine and store in a dry place.

9. TROUBLESHOOTING.

9.1. Troubleshooting - N.B. all corrective actions should be carried out by suitably qualified person/s.


Problem	Possible fault/cause	Remedy
The Diesel engine will not start	The governor lever is not at START position	Set lever to START position
	Emergency STOP button activated (depressed)	Re-set emergency STOP button
	Insufficient fuel	Refill with fuel
	Fuel injection pump does not deliver fuel or delivers insufficient fuel	Remove the injector pump and have it tested
	Check the engine oil level	The specified oil level should be to the upper lever
	The injector has severe carbon build-up	Clean the injector
	The start motor turns slowly	Check battery performance and all connections
	The battery is flat	Charge or replace with a new one
The generator is not producing power	Main breaker switch has not been turned ON	Turn the main breaker to the ON position
	Alternator brushes worn	Replace the brushes
	The contact in the socket is not good	Make sure plugs are fully inserted into sockets
	The rated speed is too HIGH or too LOW	Adjust engine speed to produce 52 Hz with no load
	AVR is damaged	Replace AVR

10. SPECIFICATIONS

Model		DHY6000SE	DHY6000SE/LR	DHY8000SE	DHY8000SE/LR
Generator	Frequency Hz	50 Hz			
	Continuous Output Power kW	4.5 kW		5.5 kW	
	Max Power	5.2 kW		6.0 kW	
	Voltage AC Volts	115VAC/230VAC			
	Sockets	16A + 32A @115V - 32A @230V			
	Fuel Tank capacity (Litres)	15	25	15	25
	DC Output Volts - Amps	12V 8.3A			
	Battery	12 v 36Ah			
	Engine	Engine Type	Diesel		
Engine		Hyundai D400, Forced Air-cooled, OHV		Hyundai D450 , Forced Air-cooled, OHV	
Power Output HP		9.5 HP		11 HP	
Start method		Electric			
Displacement cc		418 cc		452 cc	
Engine Speed rpm		3000 rpm			
Lubrication Oil		SAE 10W/30 or 15W/40 (API CH-4/CF/SJ/SL diesel engine oil grade or higher)			
Lubrication Oil Capacity (Litres)		1.75 Litres			
	Rated Power (kW)	5.2 kW		6.0 kW	
	Power Factor cos ^ϕ	1			
	Voltage Regulation	Automatic Voltage Regulation - A.V.R.			
Weight - Dimensions	Nett Weight kG	150	154	154	158
	Dimensions (L x W x H) mm	920 x 520 x 740	920 x 520 x 840	920 x 520 x 740	920 x 520 x 840

Model		DHY8000SELR-T
Generator	Frequency Hz	50 Hz
	Continuous Output Power kW	5.0 kW / 6.3 kVA
	Max Power	5.8 kW / 7.3 kVA
	Voltage AC Volts	230 VAC/400VAC
	Sockets	32A @230VAC - 16A@400VAC
	Fuel Tank capacity (Litres)	25
	DC Output Volts - Amps	12V 8.3A
	Battery	12 v 36Ah
Engine	Engine Type	Diesel
	Engine	Hyundai D450 , Forced Air-cooled, OHV
	Power Output HP	11 HP
	Start method	Electric
	Displacement cc	452 cc
	Engine Speed rpm	3000 rpm
	Lubrication Oil	SAE 10W/30 or 15W/40 (API CH-4/CF/SJ/SL diesel engine oil grade or higher)
	Lubrication Oil Capacity (Litres)	1.75 Litres
	Rated Power (kW)	6.0 kW
	Power Factor cos ϕ	1 / 0.8
	Voltage Regulation	Automatic Voltage Regulation - A.V.R.
Weight - Dimensions	Nett Weight kG	158
	Dimensions (L x W x H) mm	920x520x840

11. WIRING DIAGRAM

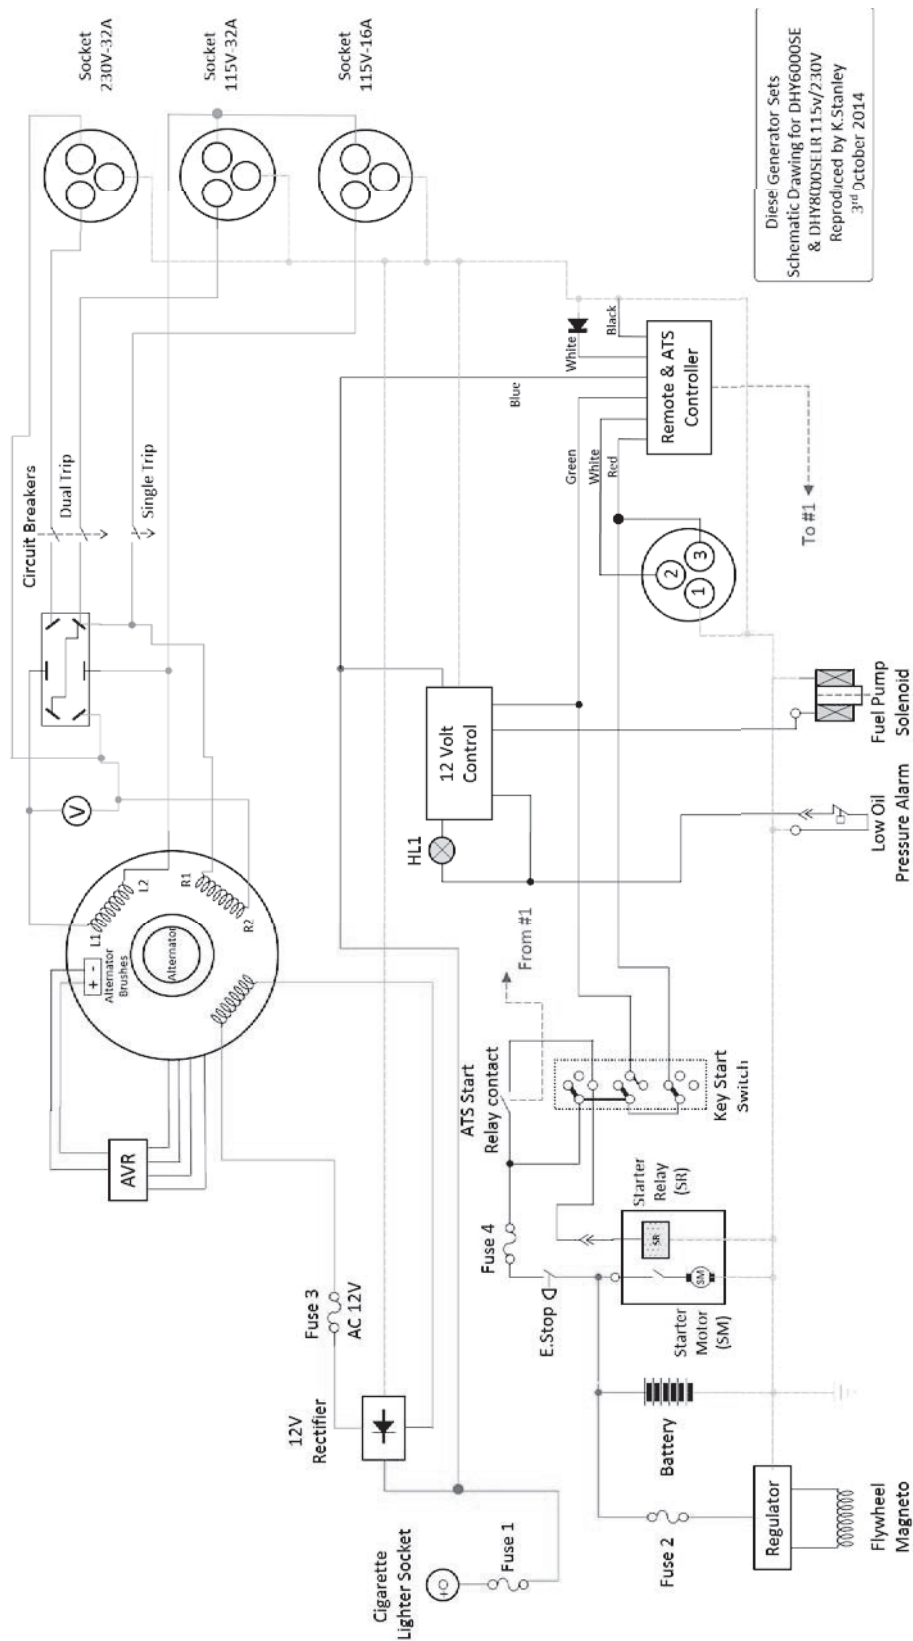

11.1. (N.B. Subject to change without prior notice).

12. SERVICE RECORD SHEET

[illegible]

13. GENPOWER CONTACT DETAILS

13.1. Postal address;

Genpower Limited, Isaac Way, Pembroke Dock,
Pembrokeshire, SA72 4RW, UK.

13.2. Telephone and Fax contact numbers;

Office +44 (0) 1646 687880

13.3. Email contact;

Technical service@genpower.co.uk

13.4. Web site;

www.hyundaipowerequipment.co.uk

CE Declaration of Conformity DoC

In accordance with EN ISO 17050-1:2010

We

Company name: Genpower Ltd
Postal address: Isaac Way, Pembroke Dock
Postcode: SA72 4RW
City: Pembrokeshire
Telephone number: 01646 687 880
E-Mail address: aftersales@genpower.co.uk

declare that the DoC is issued under our sole responsibility and belongs to the following product:

Model/Product: DHY6000SE(LR), DHY8000SELR, DHY6100SE(LR), DHY8100SELR
Description: 3000RPM Silenced Generator

Object of the declaration (identification of apparatus allowing traceability; it may include a colour image of sufficient clarity where necessary for the identification of the apparatus):

See Below



The object of the declaration described above is in conformity with the relevant Union harmonisation legislation:

CE-MD directive : (2006/42/EC)	2011/65/EU+(EU)2015/863
2000/14/EC Noise Emissions Directive	REACH SVHC 224
Directive of Electro Magnetic Compatibility 2014/30/EU	
EURO V : (EU) 2016/1628	

The following harmonised standards and technical specifications have been applied:

Title, Date of standard/specification:

EN ISO 8528-13:2016
EN 60204-1:2018,
EN ISO 12100:2010
EN 55012:2007+A1:2009
EN IEC 61000-6-1:2019

Sound Information

Measured Sound Power Level – 96dB(A)
Guaranteed Sound Power Level – 96dB(A)

Signed for and on behalf of:

Genpower Ltd

09/11/2022

Roland Llewellyn,
Managing Director

UKCA Declaration of Conformity DoC No:

In accordance with EN ISO 17050-1:2010

We

Company name: Genpower Ltd
Postal address: Isaac Way, Pembroke Dock
Postcode: SA72 4RW
City: Pembrokeshire
Telephone number: 01646 687 880
E-Mail address: aftersales@genpower.co.uk

declare that the DoC is issued under our sole responsibility and belongs to the following product:

Model/Product: DHY6000SE/LR, DHY8000SE/LR, DHY8000SELR-T
Description: 3000rpm Diesel Generator

Object of the declaration (identification of apparatus allowing traceability; it may include a colour image of sufficient clarity where necessary for the identification of the apparatus):

See Below



The object of the declaration described above is in conformity with the relevant Union harmonisation legislation:

2008 (S.I. 2008/1597) Machinery Directive	
the Eletromagnetic Compatibility Regulations 2016 of United Kingdom (2014/30/EU EMC Directive)	
2000/14/EC Noise Emissions Directive	
97/68/EC NRMM Emissions Directive	

The following harmonised standards and technical specifications have been applied:

Title, Date of standard/specification:

EN ISO 8528-13:2016	
EN 55012:2007+A1	
EN 61000-6-1:2019	

Additional information:

Signed for and on behalf of:

Genpower Ltd	09/11/2022	Roland Llewellyn, Managing Director	
Place of issue	Date of issue	Name, function, signature	

HYUNDAI

POWER PRODUCTS



GENUINE PRODUCT OF
HYUNDAI CORPORATION

For Inquiries, Please Contact:
GENPOWER LTD
Isaac Way, London Road,
Pembroke Dock, UK, SA72 4RW.
T: +44 (0) 1646 687 880
E: info@hyundaipowerproducts.co.uk
www.hyundaipowerproducts.co.uk